


botonera dibujada en posición D.L.

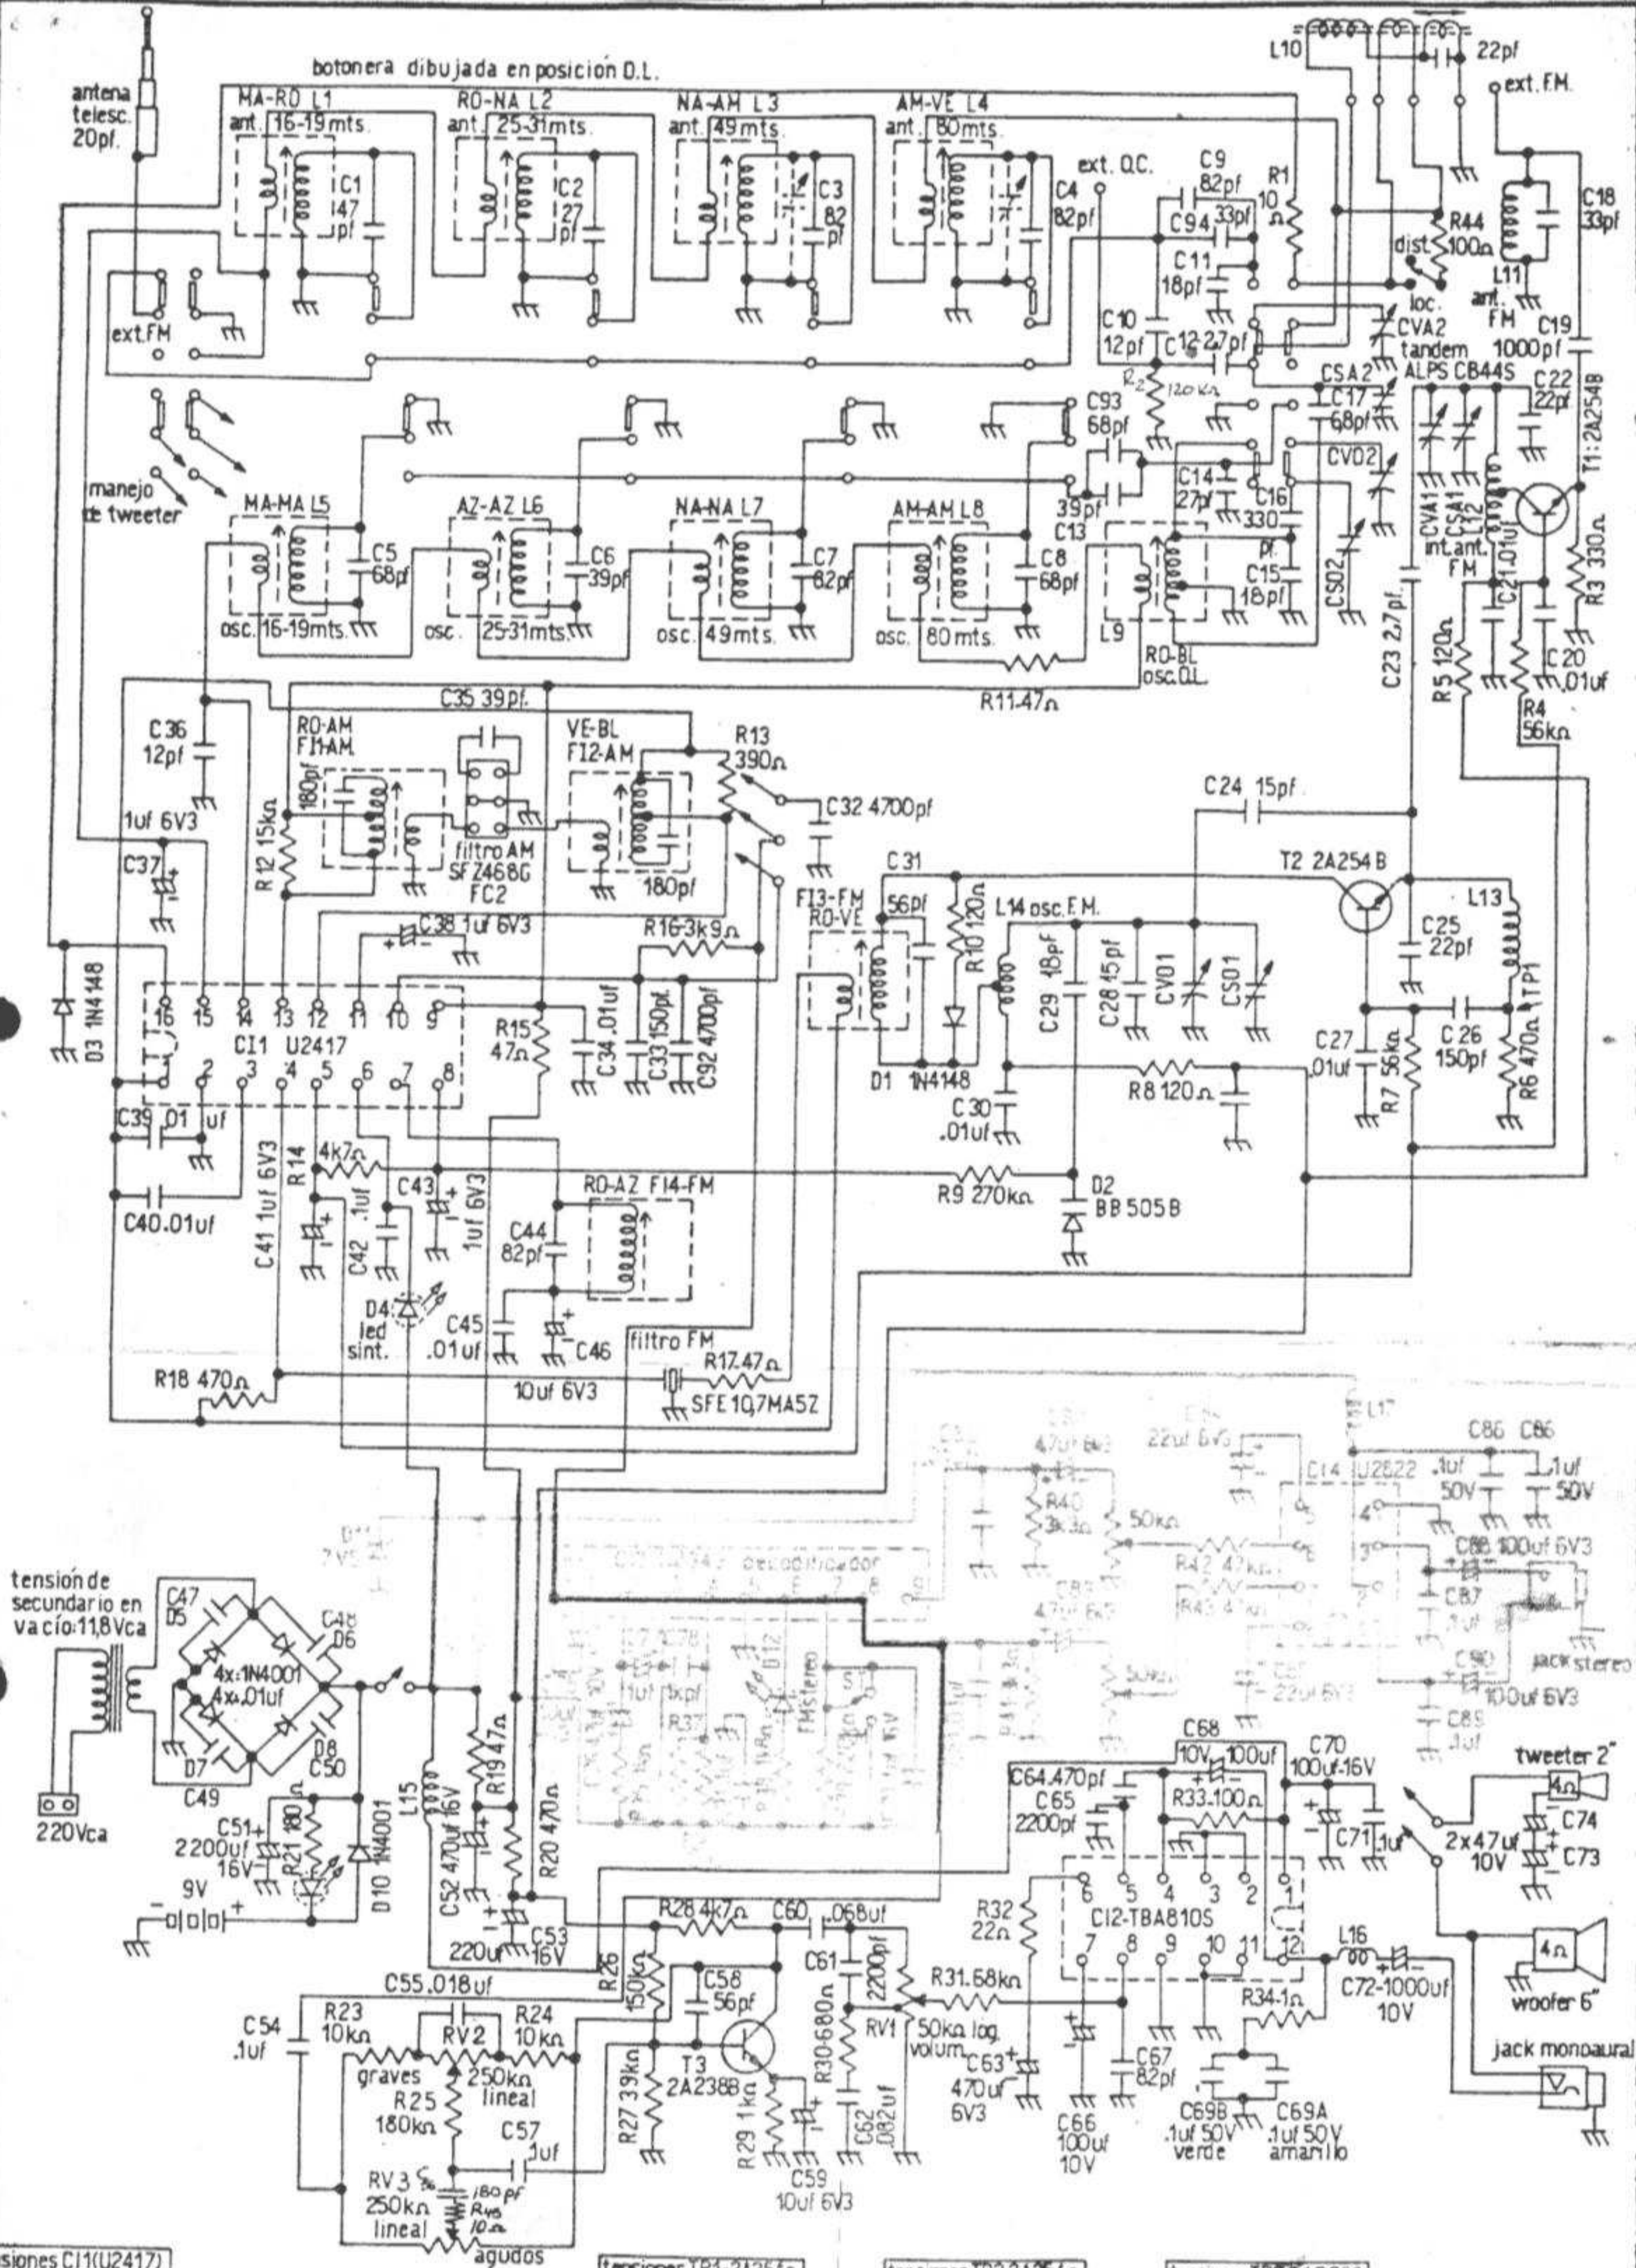

tensiones CI1(U2417)		
ter.	A.M.	F.M.
1	1,05	1,4
2	0	0
3	1,05	1,4
4	1,05	1,4
5	0,5	2,5
6	12,6	12,3

tensiones CI2(TBA810S)		
terminal	tension	
1	13,8	
2	0	

tensiones CI3(T2A238B)

tensiones TR1-2A254c		
ter.	A.M.	F.M.
E	0	0,5
B	0,5	1,2
C	12,3	11

tensiones TR2-2A254c		
ter.	A.M.	F.M.
E	0	0,5
B	0,5	1,3
C	12,5	11,1

tensiones TR3-2A238B		
ter.	A.M.	F.M.
E	1,6	1,5
B	2,3	2,1
C	4,5	4,4

NOTA: LA ZONA DE BAJO CONTRASTE CORRESPONDE AL MODELO ESTEREO.