


9. Schematic Diagrams

9-1 Schematic Diagrams

WARNING

POWER MUST BE DISCONNECTED
BEFORE SERVICING THIS APPLIANCE

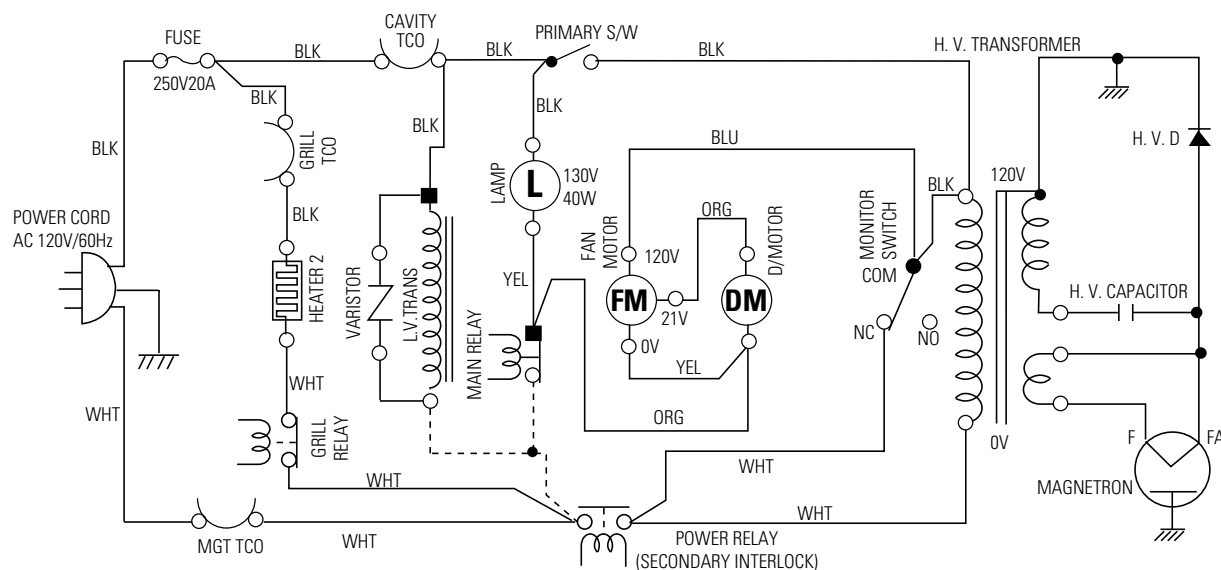

NOTE : CIRCUIT SHOWN WITH DOOR IS OPENED POSITION.

NOTE : FOR SERVICE REPLACEMENT USE 16 GA 105°C THERMOPLASTIC COVERED WIRE EXCEPT FOR HIGH VOLTAGE LEADS OR AS NOTED ON SPECIAL LEADS.

1. INPUT : 120V 60HZ
2. DOOR : OPEN
3. LAMP : ON
4. - - - : P.C.B PATTERN
5. ■ : P.C.B IN/OUT POINT

